

# Appia Life 1 Group


## Installation Requirements

**SIMONELLI** | GROUP

NORTH AMERICA

### ☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve



Nema 5-15 (receptacle)

### ☐ Power


- Volts: 110 (range of 110-125)
- Watts: 1500
- Amp draw: 13
- Receptacle: Nema 5-15
- Outlet needs to be within 3ft

### ☐ Drain

- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.

### ☐ Counter Space & Drain Hole Location



- Height: 20 inches
- Depth: 21 inches
- Width: 16 inches

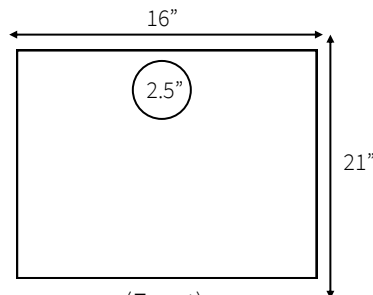

(Front)

### ☐ Photo

- Please attach a photo of the completed worksite.

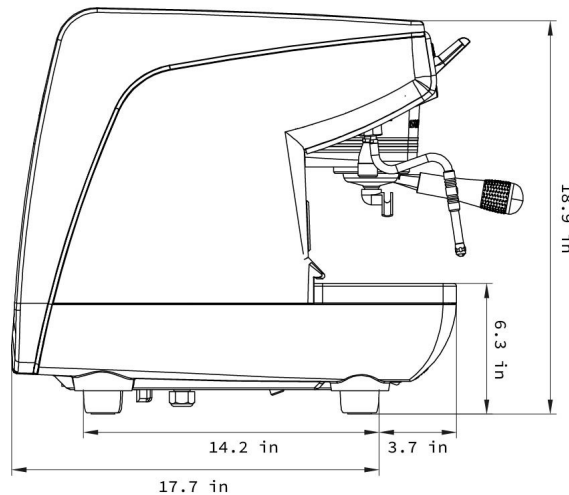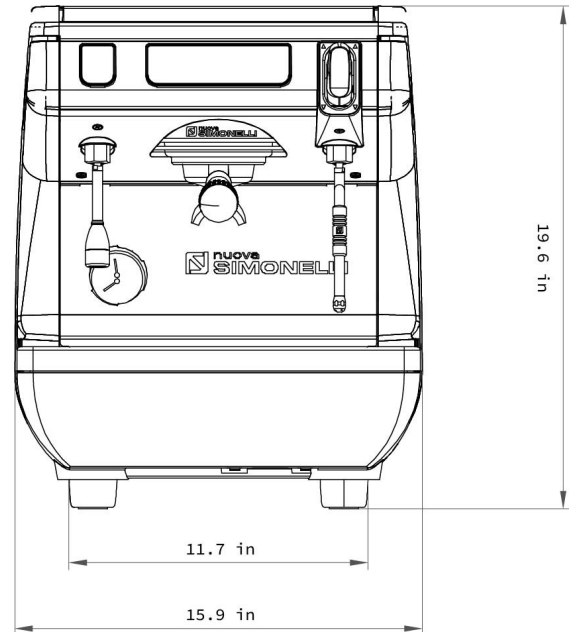

I, the customer, understand that these requirements must be in when the installer arrives. Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Sales Order: \_\_\_\_\_

**SIMONELLI** | USA  
www.simonelliusa.com

6940 Salashan Parkway Ferndale, WA 98248  
(p) 360-366-2226 (f) 360-366-4015



NSF / ANSI Std.4

# Appia Life 2 Group


## Installation Requirements

**SIMONELLI** | GROUP

NORTH AMERICA

### ☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve



Nema 6-20  
(receptacle)

### ☐ Power


- Volts: 220 (range of 208-240)
- Watts: 3400
- Amp draw: 17
- Receptacle: Nema 6-20
- Outlet needs to be within 3ft

### ☐ Drain

- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.



### ☐ Counter Space & Drain Hole Location

- Height: 20 inches
- Depth: 21 inches
- Width: 31 inches

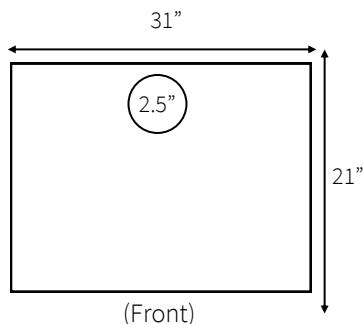

### ☐ Photo

- Please attach a photo of the completed worksite.

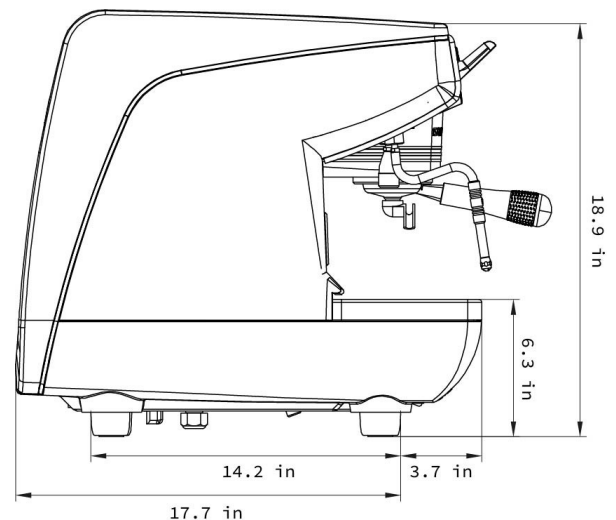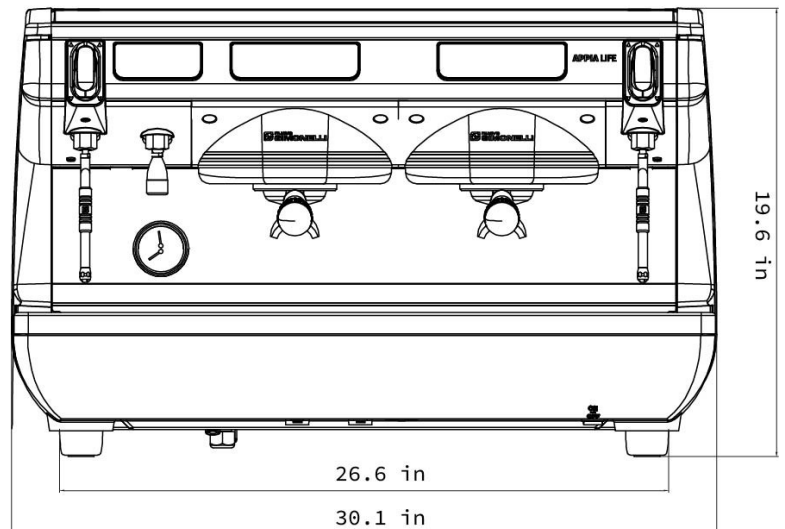

I, the customer, understand that these requirements must be in when the installer arrives. Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Sales Order: \_\_\_\_\_

**SIMONELLI** | USA  
www.simonelliusa.com

6940 Salashan Parkway Ferndale, WA 98248  
(p) 360-366-2226 (f) 360-366-4015



NSF / ANSI Std.4

# Appia Life 3 Group


## Installation Requirements

**SIMONELLI** | GROUP

NORTH AMERICA

### ☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve



Nema L6-30  
Twist  
(receptacle)

### ☐ Power


- Volts: 220 (range of 208-240)
- Watts: 5000
- Amp draw: 23
- Receptacle: Nema L6-30 Twist
- Outlet needs to be within 3ft

### ☐ Drain

- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.



### ☐ Counter Space & Drain Hole Location

- Height: 20 inches
- Depth: 21 inches
- Width: 40 inches

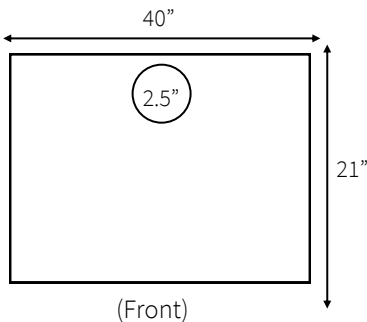

### ☐ Photo

- Please attach a photo of the completed worksite.

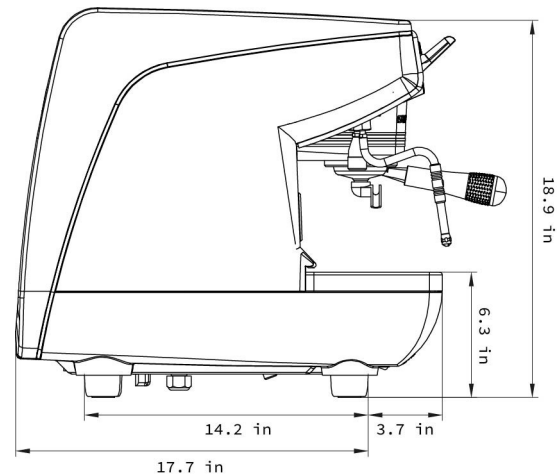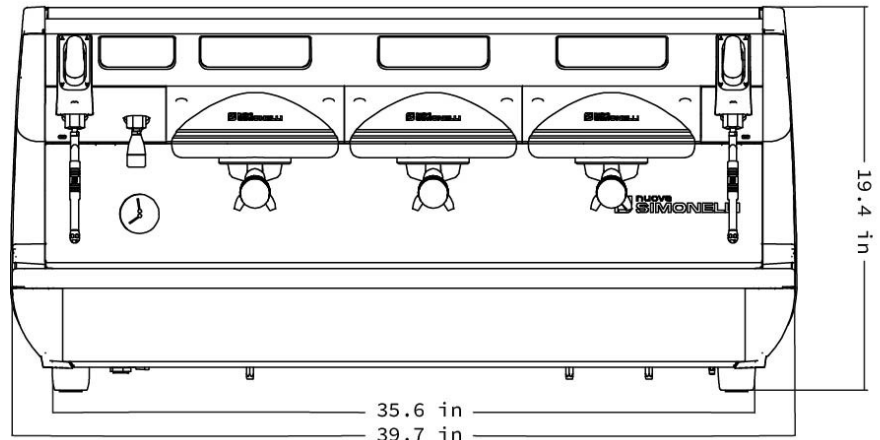

I, the customer, understand that these requirements must be in when the installer arrives. Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Sales Order: \_\_\_\_\_

**SIMONELLI** | USA  
www.simonelliusa.com

6940 Salashan Parkway Ferndale, WA 98248  
(p) 360-366-2226 (f) 360-366-4015



NSF / ANSI Std.4

# Appia Life Compact 2 Group 110v


## Installation Requirements

**SIMONELLI** | GROUP

NORTH AMERICA

### ☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve




Nema 5-15 (receptacle)

### ☐ Power

- Volts: 110 (range of 110-125)
- Watts: 1500
- Amp draw: 13
- Receptacle: Nema 5-15
- Outlet needs to be within 3ft



### ☐ Drain

- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.

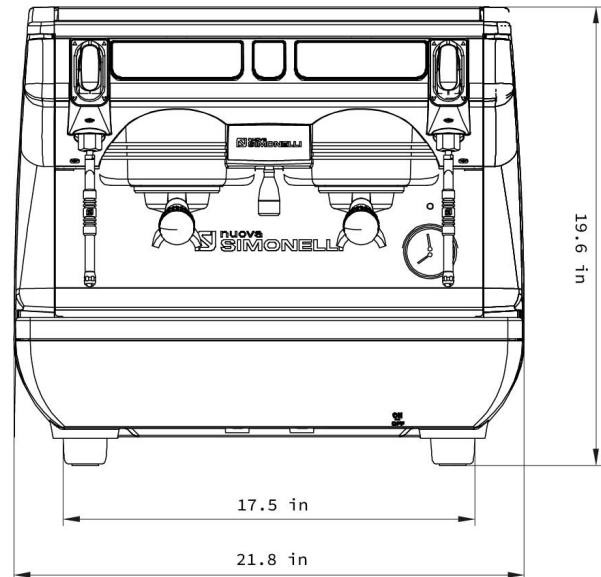

### ☐ Counter Space & Drain Hole Location

- Height: 20 inches
- Depth: 21 inches
- Width: 22 inches

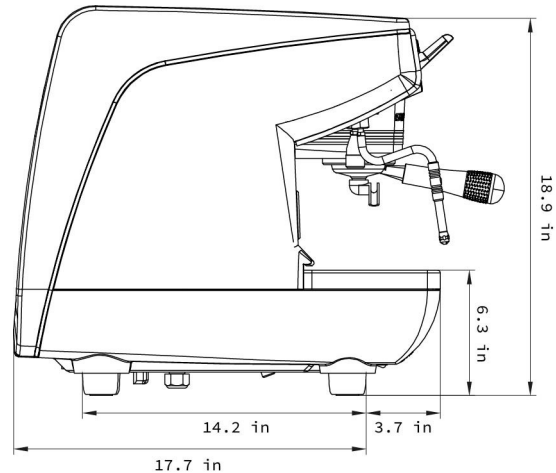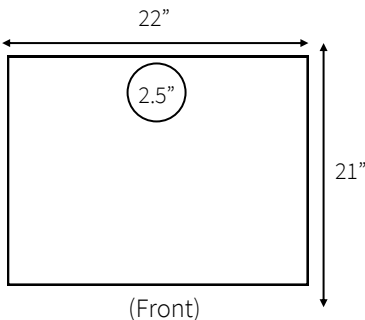

### ☐ Photo

- Please attach a photo of the completed worksite.

I, the customer, understand that these requirements must be in when the installer arrives. Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Sales Order: \_\_\_\_\_

**SIMONELLI** | USA  
www.simonelliusa.com

6940 Salashan Parkway Ferndale, WA 98248  
(p) 360-366-2226 (f) 360-366-4015



NSF / ANSI Std.4

# Appia Life Compact 2 Group 220v


## Installation Requirements

**SIMONELLI** | GROUP

NORTH AMERICA

### ☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve




Nema 6-20  
(receptacle)

### ☐ Power

- Volts: 220 (range of 208-240)
- Watts: 3000
- Amp draw: 14
- Receptacle: Nema 6-20
- Outlet needs to be within 3ft


### ☐ Drain

- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.

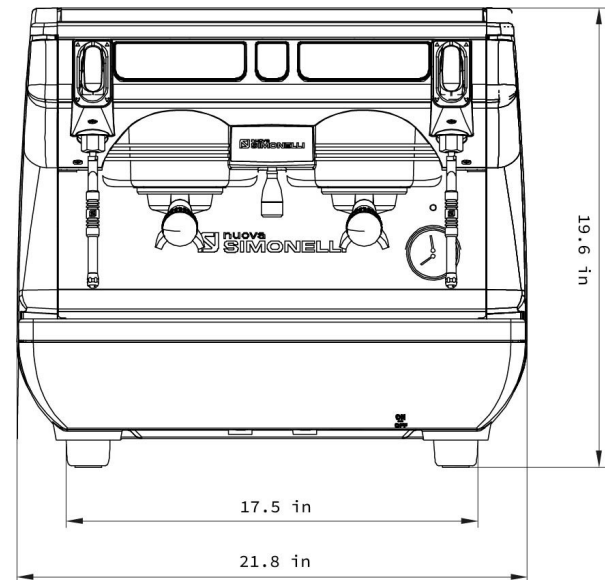


### ☐ Counter Space & Drain Hole Location

- Height: 20 inches
- Depth: 21 inches
- Width: 22 inches

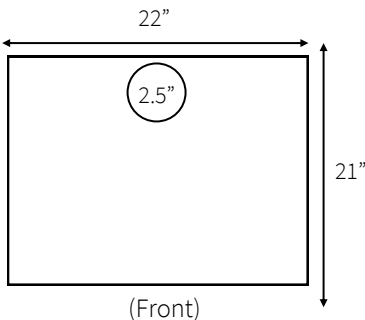

### ☐ Photo

- Please attach a photo of the completed worksite.

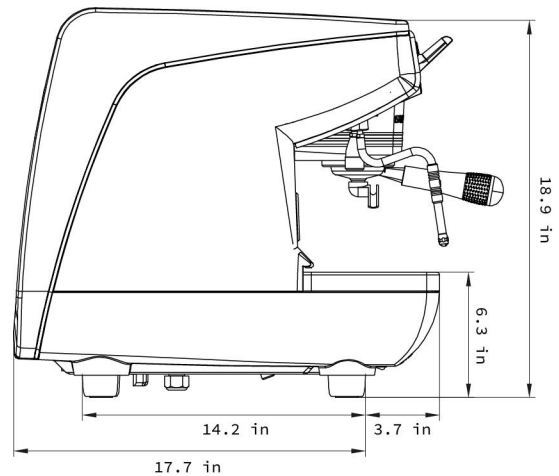

I, the customer, understand that these requirements must be in when the installer arrives. Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Sales Order: \_\_\_\_\_

**SIMONELLI** | USA  
www.simonelliusa.com

6940 Salashan Parkway Ferndale, WA 98248  
(p) 360-366-2226 (f) 360-366-4015



NSF / ANSI Std.4